

WHAT

The project involves rebuilding about 4 miles of 138-kilovolt transmission line and upgrading a substation.

WHY


The existing transmission line consists of 60-year-old wooden poles that require frequent maintenance. An upgrade to modern steel poles reduces the need for ongoing power line maintenance and improves the line's operational performance. The planned substation upgrades also help to reduce the likelihood of extended power outages and speed recovery of service when outages occur.


WHERE

The project area Includes:

- $\cdot \ \text{City of Anderson} \\$
- · Madison County



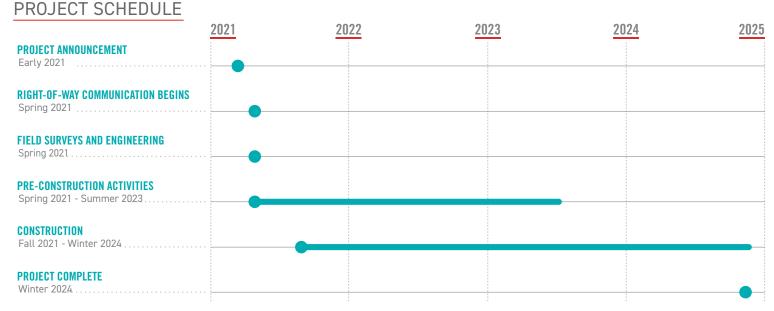

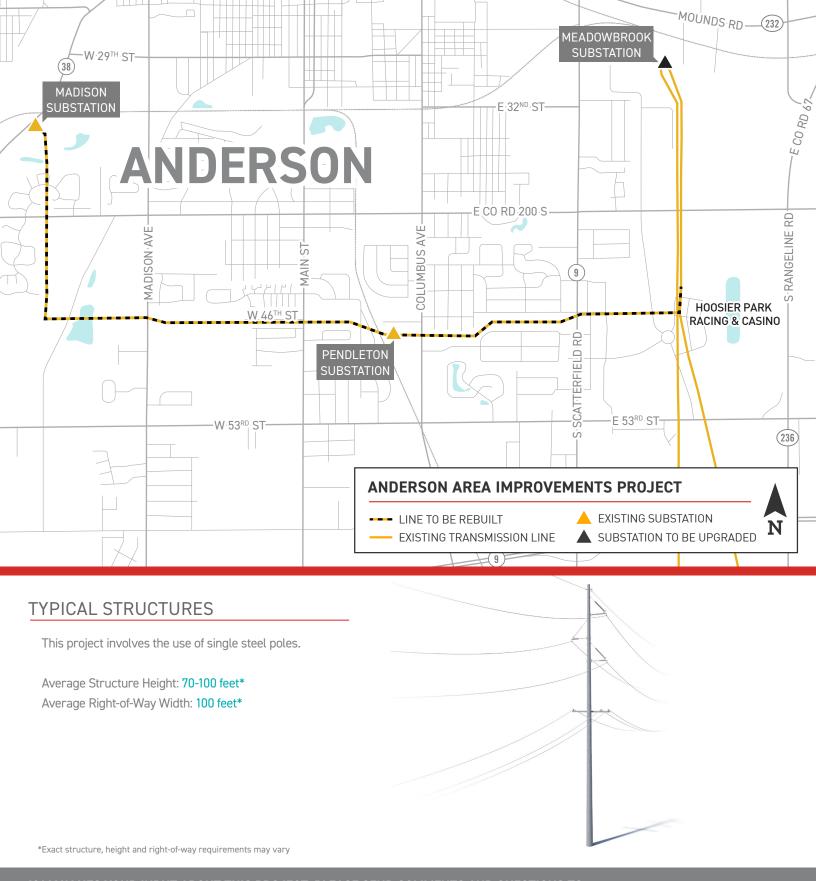

I&M VALUES YOUR INPUT ABOUT THIS PROJECT. PLEASE SEND COMMENTS AND QUESTIONS TO:

BRIAN RECKER

Project Outreach Specialist 380-205-5381 brecker@aep.com www.indianamichiganpower.com/anderson

