

# YORKTOWN

## AREA IMPROVEMENTS



An AEP Company  
BOUNDESS ENERGY™

Indiana Michigan Power (I&M) plans power grid upgrades to increase electric reliability in eastern Indiana. The Yorktown Area Improvements Project involves upgrading about 2 miles of electric transmission line.



### WHAT

The project includes rebuilding about 2 miles of 34.5 kilovolt (kV) transmission line to 69 kV standards.

### WHY

The improvements:


- Strengthen the local electric transmission system
- Reduce the likelihood of power outages
- Speed recovery of service when outages occur
- Prepares the local electric system to support future needs in the area

### WHERE

The upgrades take place in the Yorktown area. The proposed route travels north from an electrical substation located northeast of the intersection of South Nebo and West River roads along the western side of Yorktown. The line then follows the railroad east.



### PROJECT SCHEDULE

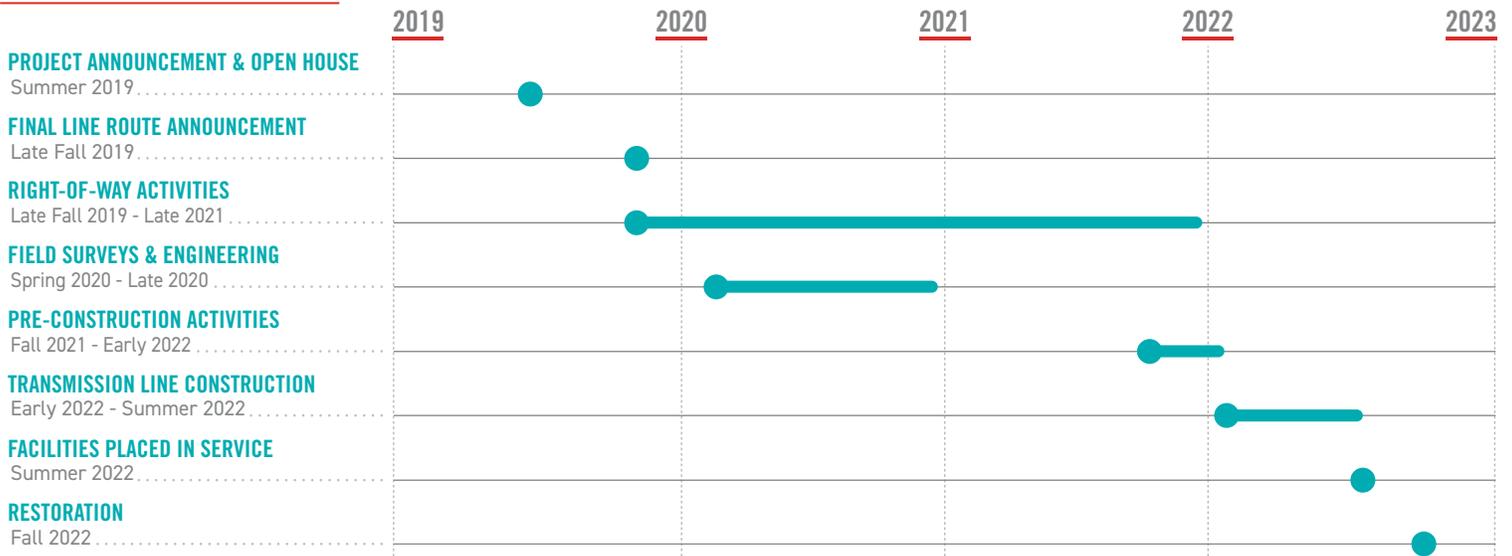


\*Timeline subject to change.

## TYPICAL STRUCTURES

I&M will build the line with steel monopole structures averaging 75-feet in height. Structures will be placed within a 60-foot right-of-way.

I&M is committed to meeting the energy needs of customers while protecting the environment and natural beauty of the region.

\*Exact structure, height and right-of-way requirements may vary

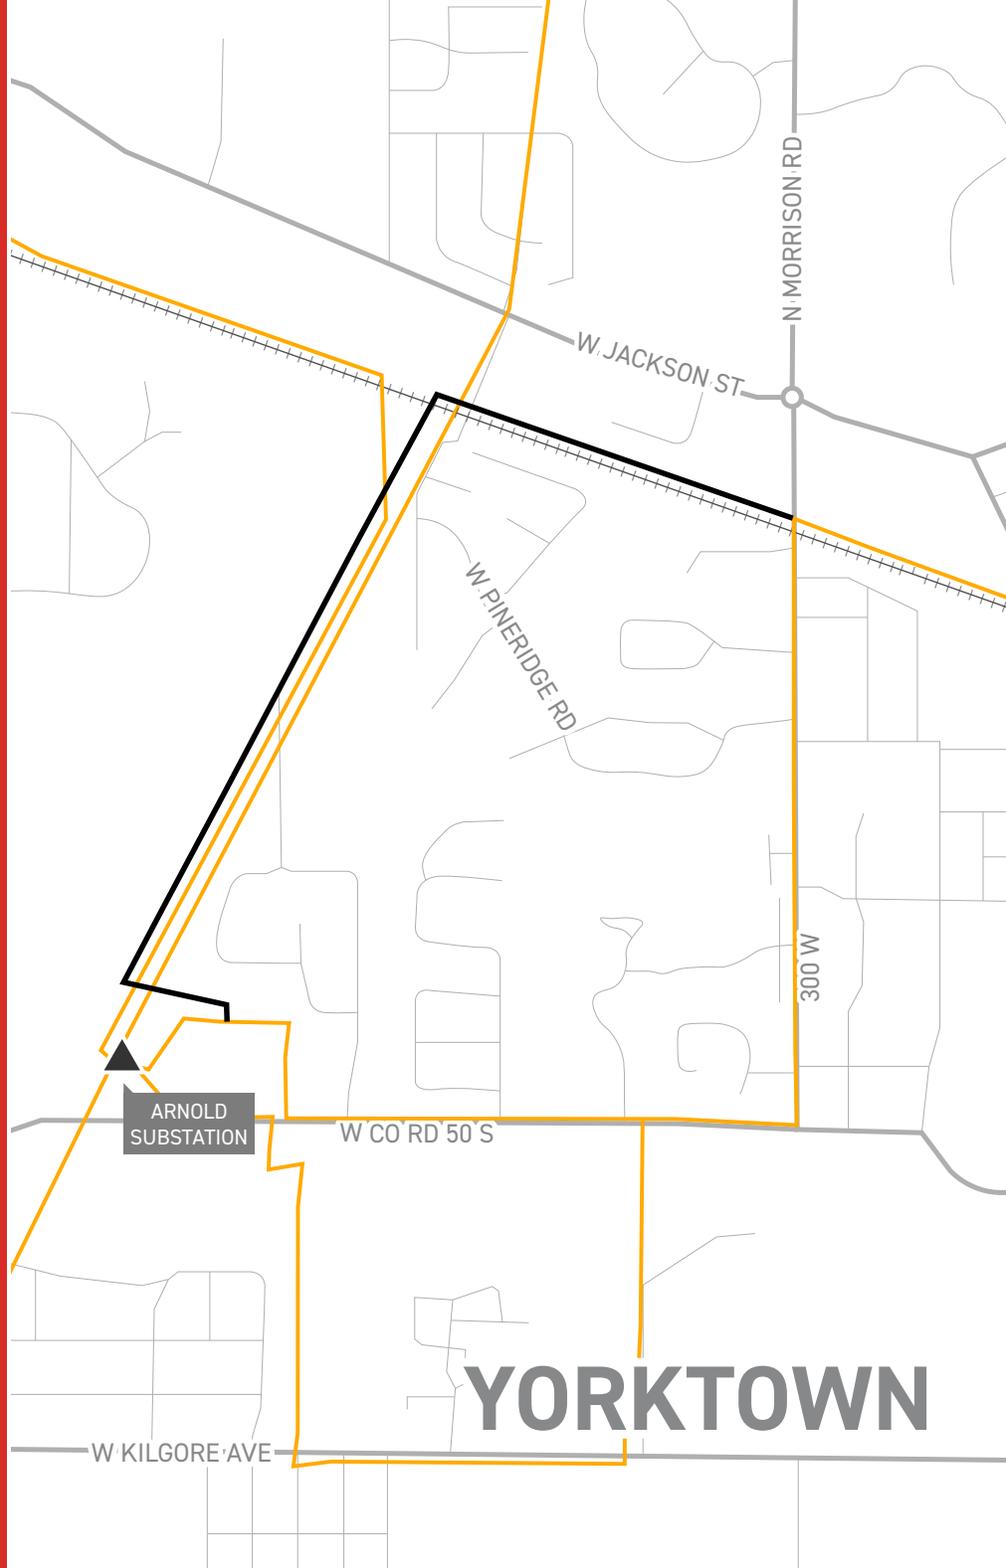

### YORKTOWN AREA IMPROVEMENTS PROJECT

- EXISTING TRANSMISSION LINE
- ▲ EXISTING SUBSTATION
- PROPOSED ROUTE



I&M VALUES YOUR INPUT ABOUT THIS PROJECT. PLEASE SEND COMMENTS AND QUESTIONS TO:

✉ Indiana Michigan Power  
I&M Outreach Team  
P.O. Box 60  
Fort Wayne, IN 46801

✉ [IM\\_Outreach@aep.com](mailto:IM_Outreach@aep.com)  
☎ 833-441-2260  
➡ [IndianaMichiganPower.com/Yorktown](http://IndianaMichiganPower.com/Yorktown)

