


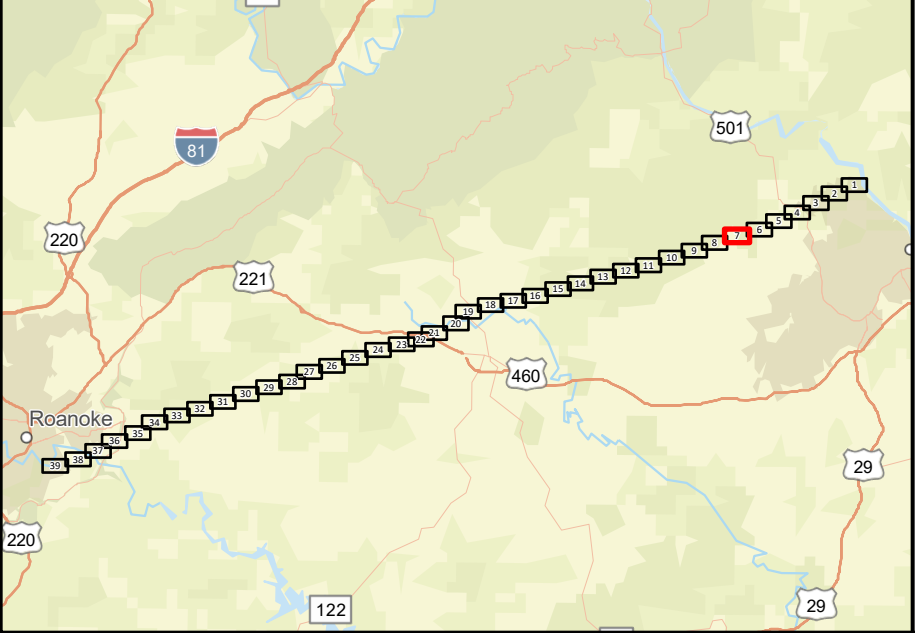

<ul style="list-style-type: none">▲ Existing APCo Substation— Study Segment--- Existing APCo Transmission Line to be Retired— Existing APCo Transmission Line (115-238 kV)⛪ Place of Worship	<ul style="list-style-type: none">— Road--- Natural Gas Pipeline— Desktop Stream (NHD)Desktop Wetlands (NWI)Waterbody (NHD)	<ul style="list-style-type: none">VOF EasementParcelMap Tile	<div><p>An AEP Company</p><p>BOUNDLESS ENERGY™</p></div>	<p>Transmission line routes are preliminary and subject to change</p> <p>1" = 200 ft <small>when printed at 22x34</small></p> <div><p>0 200 400 600 Feet</p></div> <p>Imagery Source: VGIN Aerial Imagery</p> <p>January 12, 2022</p>		<h2>Aerial Map 7 of 39</h2> <p>Reusens - Roanoke Transmission Line Rebuild Project</p>
--	---	--	--	--	---	--